


Checklist for Pump System

| Customer data | | | |
|-----------------|--|-----|--|
| Company Name | | | |
| Contact person | | | |
| Company address | | | |
| Country | | | |
| Phone | | Fax | |
| Email | | www | |

| Location of the Pump System | | | |
|-----------------------------|--|-----------|--|
| Nearest Town, Country | | | |
| Latitude | | Longitude | |

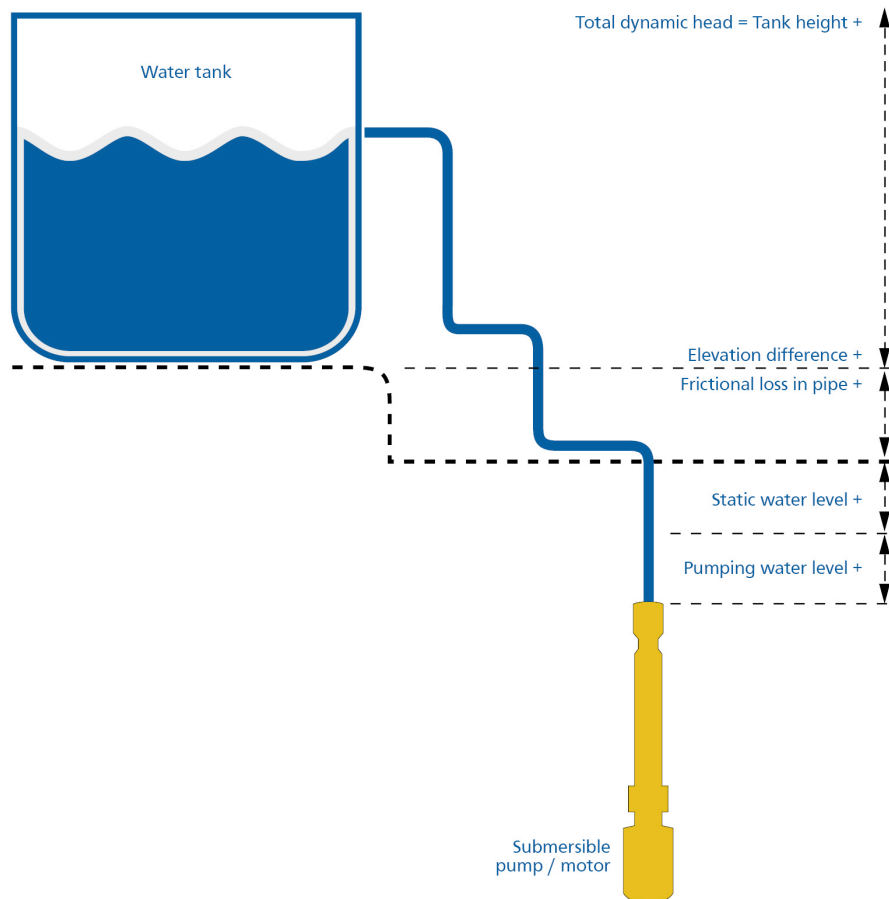

| Well | |
|----------------------------------|------------------------|
| Static water level [m] | |
| Dynamic well characteristics [m] | at [m ³ /h] |
| Well diameter [inch] | |
| Water quality data | |

| Others | |
|--|--|
| Tank height [m] | |
| Tank volume [m ³] | |
| Volume of water required a day [m ³] | |
| Horizontal distance between well and tank [m] | |

| | | | | | |
|--|--|--------------------------|--|-------|--------------------------|
| Piping size | Total length [m] | | | | |
| | Diameter [inch] | | | | |
| Deviation North/South direction | North | <input type="checkbox"/> | | South | <input type="checkbox"/> |
| Watermeter required | Yes | <input type="checkbox"/> | | No | <input type="checkbox"/> |
| Well head offer | Yes | <input type="checkbox"/> | | No | <input type="checkbox"/> |
| Support structure offer | Ground SGM | <input type="checkbox"/> | | No | <input type="checkbox"/> |
| Piping offer | Yes | <input type="checkbox"/> | | No | <input type="checkbox"/> |
| Information on utilization of the system | Min. water output of a certain month (month) | | | | |
| | Optimization all year round | | | | |
| Intended use of water | Min. Drinking water | | | | |
| | Field irrigation | | | | |

| Information on utilization of the system | | | | |
|--|-----|--------------------------|-----------|--------------------------|
| Optimization all year round | Yes | <input type="checkbox"/> | No | <input type="checkbox"/> |
| Optimization for a period from month: | | | to month: | |